

INSTALLATION INSTRUCTION

LDC480 Series

DIN Rail Power Supply



MAIN FEATURES

- High efficiency and ultra compact size
- Active PFC for optimal efficiency
- Up to 60°C operating temperature with no derating
- Constant current or Hiccup mode limitation, user settable
- Easy parallelable for power increase

Discontinued models

LDC480-24	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 24 VDC, 20 A
LDC480-24P	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 24 VDC, 20 A + ORing Circuit
LDC480-48	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 48 VDC, 10 A
LDC480-48P	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 48 VDC, 10 A + ORing Circuit
LDC480-72	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 72 VDC, 6.7 A
LDC480-72P	INPUT: 100 – 240 VAC, 4.8 - 2.4 A, 50 - 60 Hz OUTPUT: 72 VDC, 6.7 A + ORing Circuit

READ THIS CAREFULLY BEFORE INSTALLATION!	VOR DER INSTALLATION BITTE FOLGENDE SICHERHEITSHINWEISE BEACHTEN!	LEGGERE ATTENTAMENTE PRIMA DELL'INSTALLAZIONE!	A LIRE ATTENTIVEMENT AVANT L'INSTALLATION!
Before operating, read this document thoroughly and retain it for future reference. Non-respect of these instructions may reduce performances and safety of the devices and cause danger for people and property. The products must be installed, operated, serviced and maintained by qualified personnel in compliance with applicable standards and regulations. Do not open the device, it does not contain replaceable components, the tripping of the internal fuse (if included) is caused by an internal failure. Do not repair or modify the device, if malfunction or failure should occur during operation, send unit to the factory for inspection. No responsibility is assumed by Bel for any consequences deriving from the use of this material.	Lesen Sie dieses Dokument vor der Inbetriebnahme sorgfältig durch und bewahren Sie es zum späteren Nachschlagen auf. Die Nichtbeachtung dieser Anweisungen kann die Funktion und Sicherheit der Geräte beeinträchtigen und birgt Gefahren für Personen und Eigentum. Die Geräte müssen von qualifiziertem Personal unter Einhaltung der geltenden Normen und Vorschriften installiert, betrieben, gewartet und instand gehalten werden. Öffnen Sie das Gerät nicht, es enthält keine austauschbaren Komponenten, das Auslösen der internen Sicherung (falls vorhanden) ist stets auf tiefgehende Fehler im Schaltkreis zurück zu führen. Reparieren oder modifizieren Sie das Gerät nicht. Sollte während des Betriebs eine Fehlfunktion oder ein Defekt auftreten, schicken Sie das Gerät zur Überprüfung ins Werk. Bei übernimmt keine Haftung für die Folgen, die sich aus dem Einsatz dieses Gerätes ergeben.	Prima dell'installazione, leggere attentamente questo documento istruzioni e conservare per future consultazioni. L'inosservanza delle presenti istruzioni può compromettere le caratteristiche e la sicurezza dell'apparecchio e causare pericolo per le persone e le cose. Il prodotto deve essere installato, utilizzato e riparato da personale qualificato e nel rispetto delle normative vigenti. Non aprire il prodotto, esso non contiene componenti sostituibili, il guasto del fusibile interno (se previsto) è causato da un guasto interno. Non tentare di riparare o modificare il prodotto, se durante il funzionamento si verificano guasti o anomalie, inviarlo al produttore per il controllo. Bel non si assume nessuna responsabilità per qualunque conseguenza derivante dall'uso di questo materiale.	Les ces instructions avant l'installation, conserver ce manuel pour référence future. Défaut de se conformer à ces instructions peut affecter les caractéristiques et la sécurité du dispositif, et causer du danger aux personnes ou aux biens. Les produits doivent être installés, exploités et entretenus par du personnel qualifié et en conformité avec les règlements. N'ouvrez pas le produit, il ne contient aucune pièce réparable, le déclenchement du fusible interne (le cas échéant) est causé par un défaut interne. Ne pas essayer de réparer ou modifier le produit ; si des défaillances se produisent pendant le fonctionnement, retourner le produit au fabricant pour inspection. Bel n'assume aucune responsabilité des conséquences éventuelles découlant de l'utilisation des produits.
CAUTION	ACHTUNG	ATTENZIONE	AVERTISSEMENT
RISK OF BURNS, EXPLOSION, FIRE, ELECTRICAL SHOCK, PERSONAL INJURY. Never carry out work on live parts! Danger of fatal injury! The product's enclosure may be hot, allow time for cooling product before touching it. Do not allow liquids or foreign objects to enter into the products. To avoid sparks, do not connect or disconnect the device before having previously turned-off input power and wait for internal capacitors discharge (minimum 1 minute).	GEFAHR VON VERBRENNUNGEN, EXPLOSIONEN, FEUER, STROMSCHLAG, PERSONENSCHÄDEN. Führen Sie niemals Arbeiten an spannungsführenden Teilen durch! Gefahr von tödlichen Verletzungen! Das Gehäuse des Gerätes kann heiß sein, lassen Sie Zeit zum Abkühlen des Gerätes, bevor Sie es berühren. Lassen Sie keine Flüssigkeiten oder Fremdkörper in die Geräte eindringen. Um Überschläge zu vermeiden, schließen Sie das Gerät nicht an oder trennen Sie es nicht ohne vorher die Eingangsspannung abgeschaltet zu haben, und warten Sie die Entladung der internen Kondensatoren ab (mindestens 1 Minute).	RISCHIO USTIONI, ESPLOSIONE, INCENDIO, SCOSSA, LESIONI GRAVI. Non effettuare mai operazioni sulle parti sotto tensione! Pericolo di lesioni letali! Il contenitore può scottare, lasciar quindi raffreddare il dispositivo prima di toccarlo. Non far entrare liquidi o oggetti estranei nel dispositivo. Per evitare scintille, non collegare o scollegare l'apparecchiatura prima di avere tolto tensione di ingresso e prima che sia avvenuta la scarica dei condensatori interni (min. 1 minuto).	RISQUE DE BRULURES, EXPLOSION, INCENDIE, ELECTROCUTION, DOMMAGE AUX PERSONNES. Ne jamais effectuer des opérations sur les parties sous tension! Danger de mort! Le boîtier peut produire des brûlures, le laisser refroidir avant de toucher l'appareil. Ne faire pas pénétrer des liquides ou des corps étrangers dans l'appareil. Pour éviter des étincelles, ne pas connecter ou déconnecter l'équipement jusqu'à ce que la tension d'entrée a été supprimée et avant qu'il n'ait eu le temps de se décharger des condensateurs internes (minimum 1 minute).
INTENDED USE	BESTIMMUNGSGEMÄßER BETRIEB	USO PREVISTO	UTILISATION
These are isolated devices suitable for SELV and PELV circuitry and are designed to be mounted on DIN rail and installed inside a protective enclosure. They are intended for general use such as in industrial control, communication, and instrumentation equipment. Do not use these devices in applications where malfunction may cause injury or death.	Es handelt sich um galvanisch getrennte Geräte, die für SELV- und PELV-Anwendungen geeignet sind und für die Montage auf DIN-Schienen und die Installation in einem Schutzgehäuse konzipiert sind. Sie sind für den allgemeinen Gebrauch wie z.B. in industriellen Steuer-, Kommunikations- und Automatisierung-Anwendungen vorgesehen. Verwenden Sie diese Geräte nicht in Anwendungen, bei denen eine Fehlfunktion zu Verletzungen oder zum Tod führen kann.	I dispositivi sono isolati, adatti per applicazioni SELV e PELV, sono dotati di aggancio per il montaggio su guida DIN all'interno di quadri elettrici o contenitori di protezione, per l'utilizzo con controllori industriali, unità di comunicazione o apparecchi di misura. Non utilizzare in applicazioni in cui un eventuale guasto può comportare rischio di lesioni o di morte.	Les produits sont isolés, appropriés pour les circuits TBTS et TBTP et sont équipés d'un crochet pour montage sur rail DIN dans des armoires ou conteneurs de protection, pour utilisation avec les contrôleurs industriels, des modules de communication ou des unités de mesure. Ne pas utiliser ces dispositifs dans une application où un dysfonctionnement pourrait entraîner le risque des blessures ou de mort.
ENVIRONMENTAL CHARACTERISTICS	UMGEBUNGSBEDINGUNGEN	CARATTERISTICHE AMBIENTALI	CARACTÉRISTIQUES ENVIRONNEMENTALES
Installation in a Pollution Degree 2 environment. Do not use in wet area or subject to moisture. Carefully recycle the product and related batteries according to local regulations.	Installation in einer Umgebung mit Verschmutzungsgrad 2. Nicht in nassen Bereichen oder unter Feuchtigkeit verwenden. Das Gerät und die zugehörigen Batterien sind entsprechend den lokalen Vorschriften zu recyceln bzw. zu entsorgen.	Usare in ambienti con Grado di Inquinamento 2. Non far funzionare l'apparecchio in un ambiente umido o soggetto a formazione di condensa. Riciclare il prodotto e le batterie collegate, nel rispetto delle normative locali vigenti.	Utiliser les produits dans des environnements avec degré de pollution 2. Ne pas employer l'appareil dans un environnement humide ou soumis à la condensation. Recycler les produits et les batteries, conformément à la réglementation locale.

USER INSTRUCTIONS**1) DESCRIPTION**

DIN rail mountable primary switched-mode power supply with 90 - 264 VAC or 110 - 345 VDC input (UL not evaluated), suitable for single phase mains line and DC line.

2) INSTALLATION

Use DIN-rails according to EN 60715. Installation should be made vertically (see Fig.4). For better device stability fix the rail to the wall close to the point where the device is to be mounted. In order to guarantee sufficient convection, we recommend observing a minimum distance to other modules (see Fig. 3).

The device is provided with a thermal protection; a limited air flow can cause the thermal protection tripping.

The SMPS automatically restarts after cooling. To get normal operation reduce the temperature of the air surrounding the power supply, increase the ventilation or reduce the load (see Fig. 8)

3) CONNECTIONS

The device is equipped with pluggable screw terminals. To avoid sparks, do not connect or disconnect the connectors before having previously turned-off input power and waited for internal capacitors discharge (minimum 1 minute).

In order to comply with UL certification, use appropriate copper cables of indicated cross section, designed for operating temperature > 105°C.

Strip the connecting ends of the wires according to the indication and ensure that all strands of a stranded wire enter the terminal connection (see Fig. 5).

4) INPUT PROTECTION

The device input is provided with varistors against overvoltage. Input is provided with internal fuses 8AT / 250 VAC, thus an external short circuit / overcurrent protection must be provided by the end user (see Fig. 6).

For operation on a single-phase system, a protection fuse on the phase must be provided.

Surge protection: it is strongly recommended to provide external surge arresters (SPD) according to local regulations.

5) AC INPUT CONNECTION

The device can be connected to single phase AC lines with Vin 100 VAC or 120 – 240 VAC (see Fig. 7). Derate to 87.5% load if connected to single phase AC lines with Vin 100 VAC. Ensure that the PE conductor is properly connected. Please connect first the PE.

6) DC INPUT CONNECTION

Connect L terminal to (+) positive pole, N terminal to (-) negative pole and \oplus terminal to GND. Rated voltage 110 – 345 VDC (UL not evaluated).

The device is also suitable for photovoltaic or wind turbine applications (see Fig. 7).

7) OUTPUT CONNECTION

The device is suitable for **SELV** and **PELV** circuitry. Pay attention: LDC480-72 and LDC480-72P are not **SELV**.

Vout can be adjusted with a potentiometer to a wide range (see Fig.1). Check Vout before connecting the power supply to the load. With output voltage set to the max. value, the continuous [current x voltage] must not exceed the nominal power.

If the output current exceed 15 A the load must be wired to the power supply using all the four poles of the output connector.

8) PARALLEL CONNECTION AND REDUNDANCY

Power supplies can be connected in parallel to increase power. For paralleling for power set the llim jumper to C.C. algorithm.

Vout must be set uniformly (± 100 mV) on each power supply and the wiring must be symmetrical to ensure an equal current distribution.

Models with "P" suffix have an integrated ORing circuit. For redundant connection, use the Models "P" or an external isolating device must be used (see Accessories).

9) OUTPUT PROTECTION

The device is protected against overload (OL) / short circuit (SC) / overvoltage (OV) / overtemperature (OT). **OL and SC:** are controlled by a hiccup mode or a constant current (C.C.) mode protection with the following behaviour.

The Hiccup mode or C.C. mode are selectable with Jumper (see Fig.1)

OL behaviour in hiccup mode: Max. OL = $1.5 \times I_{in}$ the output voltage remains constant at nominal voltage for 5s and after that time the device starts an ON/OFF cycle.

OL behaviour in C.C. mode: the maximum output current is limited at $1.1 \times I_{in}$ if the load resistance is further decreased the output voltage starts to drop.

SC behaviour in hiccup mode: the device supplies $1.5 \times I_{in}$ for 5 s, after that time it switches off for 10s. The ON/OFF cycle is repeated continuously.

SC behaviour in C.C. mode: the device supplies $1.1 \times I_{in}$ continuously into the short circuit without switching off

Output OV circuit protection: the output is protected against potential OV due to internal malfunction or coming from the load for $V_{out} \geq V_{nom} \times 1.2 - 1.3$, depending on the model.

OT protection: turns off the device if the internal temperature exceeds a safe limit. The device restarts automatically after cooling down. To recover to normal operation reduce air temperature surrounding the power supply, increase cooling or reduce load (see Fig.8).

10) FEEDING DC MOTORS

It is possible to feed DC motors considering that when a motor starts-up under effort its consumption is much higher than the nominal current and it can trigger overcurrent protection (see accessory device). For these applications the C.C. (Constant Current) mode of current limitation is recommended.

NOTE: motors can generate high conducted noise on the DC line. Therefore it is not recommended to feed on the same line motors and equipment sensitive to noise.

11) OPERATION WITH BATTERY

When a battery is connected in parallel to the Output for backup purposes; the LDC480 must be set on C.C. mode to avoid battery over-charging (see accessory device).

12) ENVIRONMENTAL

These products are IP20 (according to IEC 60529, not UL evaluated), and therefore chemicals/solvents, cleaning agents and other liquids must not be used.

13) ENVIRONMENT

These power supplies are SMPS for use in applications within a Pollution Degree 2, overvoltage category II environment (overvoltage category III according to EN 50178). Do not use in wet area or subject to moisture. These products are designed for indoor use only.

14) INTENDED USE

These are isolated devices suitable for SELV and PELV circuitry and are designed to be mounted on DIN rail and installed inside a protective enclosure. They are intended for general use such as in industrial control, communication, and instrumentation equipment.

If the power supply is used in a way not specified in this manual, the protection provided by the equipment may be impaired. Don't use these devices in applications where malfunction may cause injury or death.




Manufacturer
Bel Fuse Inc.
300 Executive Drive, Suite 300
West Orange, NJ 07052
USA

Asia-Pacific +86 755 2988 5888	Europe, Middle East +353 61 49 8941	North America +1 866 513 2839
--	---	---

belfuse.com/power-solutions

© 2023 Bel Fuse Inc. BCM.00407_AH

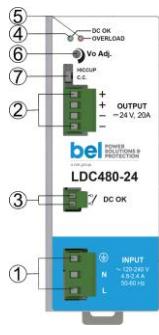FIG.1 - CONNECTIONS


- (1) AC/DC input
 (2) DC output (load)
 (3) Diagnostic Output (DC OK - dry contact, NO, 24VDC/1A)
(Note: Not present on 72 V models)
 (4) Green LED: Output OK
 (5) Red LED: Overload
 (6) Output voltage adjustment
 (7) Selectable limitation mode (Hiccup mode, C.C. mode)

Input AC Line:


- L = Line
- N = Neutral
- \ominus = Earth ground

Output:

- + = Positive DC
- - = Negative DC
- DC OK (Not present on 72 V models)

FIG.2 - DIMENSIONS

Dimension	mm (inc)
W	56 (2.20)
D	117 (4.60)
H	140 (5.51)

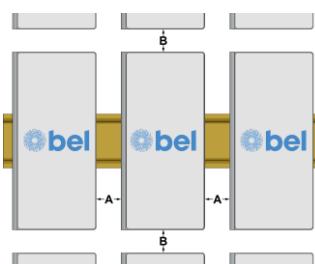
FIG.3 - DISTANCES**FIG.4 - MOUNTING / DISMOUNTING INSTRUCTIONS**

For DIN rail fastening according to IEC 60715 TH35-7.5(-15)


Mounting as shown in figure, with input terminals on lower side, with suitable cooling and maintaining a proper distance between adjacent devices as specified in the Installation Instruction of each family.

MOUNTING:


1. Tilt the unit slightly backwards.
2. Fit the unit over the top edge of the rail.
3. Slide it downward until it hits the stop.
4. Press against the bottom for locking.




1

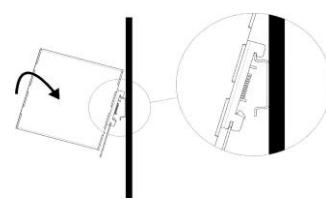

2

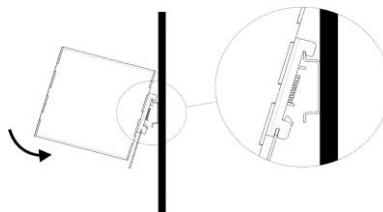


3




4

DISMOUNTING:

1. Pull down the slide clamp lever
 2. Tilt the unit upward
- Unhook the unit from the rail



1 & 2

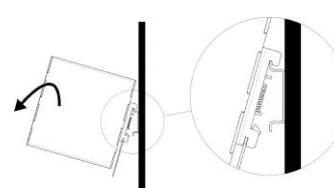

3



Manufacturer
 Bel Fuse Inc.
 300 Executive Drive, Suite 300
 West Orange, NJ 07052
 USA

Asia-Pacific +86 755 2988 5888
Europe, Middle East +353 61 49 8941
belfuse.com/power-solutions

© 2023 Bel Fuse Inc. BCM.00407_AH





FIG.5 - RECOMMENDED CONNECTING CABLE

Recommended Tightening Torque			Cable Size (Solid & Stranded)																																
Input / Output			Input / Output																																
<table border="1"> <thead> <tr> <th>MFC</th><th>Nm</th><th>Ibf in</th></tr> </thead> <tbody> <tr> <td>Dinkle</td><td>0.51</td><td>4.5</td></tr> <tr> <td>ULO</td><td>0.51</td><td>4.5</td></tr> <tr> <td>Anytek</td><td>0.57</td><td>5.0</td></tr> <tr> <td>Würth</td><td>0.57</td><td>5.0</td></tr> </tbody> </table>			MFC	Nm	Ibf in	Dinkle	0.51	4.5	ULO	0.51	4.5	Anytek	0.57	5.0	Würth	0.57	5.0	<table border="1"> <thead> <tr> <th>MFC</th><th>mm²</th><th>AWG</th></tr> </thead> <tbody> <tr> <td>Dinkle</td><td>2.5 – 0.2</td><td>12 – 28</td></tr> <tr> <td>ULO</td><td>2.5 – 0.2</td><td>12 – 28</td></tr> <tr> <td>Anytek</td><td>2.5 – 0.34</td><td>12 – 24</td></tr> <tr> <td>Würth</td><td>3.3 – 0.2</td><td>12 – 24</td></tr> </tbody> </table>			MFC	mm ²	AWG	Dinkle	2.5 – 0.2	12 – 28	ULO	2.5 – 0.2	12 – 28	Anytek	2.5 – 0.34	12 – 24	Würth	3.3 – 0.2	12 – 24
MFC	Nm	Ibf in																																	
Dinkle	0.51	4.5																																	
ULO	0.51	4.5																																	
Anytek	0.57	5.0																																	
Würth	0.57	5.0																																	
MFC	mm ²	AWG																																	
Dinkle	2.5 – 0.2	12 – 28																																	
ULO	2.5 – 0.2	12 – 28																																	
Anytek	2.5 – 0.34	12 – 24																																	
Würth	3.3 – 0.2	12 – 24																																	
Signal <table border="1"> <thead> <tr> <th>MFC</th><th>Nm</th><th>Ibf in</th></tr> </thead> <tbody> <tr> <td>Dinkle</td><td>0.2</td><td>1.7</td></tr> <tr> <td>ULO</td><td>0.2</td><td>1.7</td></tr> <tr> <td>Anytek</td><td>0.34</td><td>3.0</td></tr> <tr> <td>Würth</td><td>0.34</td><td>3.0</td></tr> </tbody> </table>			MFC	Nm	Ibf in	Dinkle	0.2	1.7	ULO	0.2	1.7	Anytek	0.34	3.0	Würth	0.34	3.0	Signal <table border="1"> <thead> <tr> <th>MFC</th><th>mm²</th><th>AWG</th></tr> </thead> <tbody> <tr> <td>Dinkle</td><td>1.5 – 0.2</td><td>14 – 28</td></tr> <tr> <td>ULO</td><td>1.5 – 0.5</td><td>16 – 28</td></tr> <tr> <td>Anytek</td><td>1.5 – 0.5</td><td>16 – 28</td></tr> <tr> <td>Würth</td><td>1.3 – 0.2</td><td>16 – 28</td></tr> </tbody> </table>			MFC	mm ²	AWG	Dinkle	1.5 – 0.2	14 – 28	ULO	1.5 – 0.5	16 – 28	Anytek	1.5 – 0.5	16 – 28	Würth	1.3 – 0.2	16 – 28
MFC	Nm	Ibf in																																	
Dinkle	0.2	1.7																																	
ULO	0.2	1.7																																	
Anytek	0.34	3.0																																	
Würth	0.34	3.0																																	
MFC	mm ²	AWG																																	
Dinkle	1.5 – 0.2	14 – 28																																	
ULO	1.5 – 0.5	16 – 28																																	
Anytek	1.5 – 0.5	16 – 28																																	
Würth	1.3 – 0.2	16 – 28																																	
			Stripping length 7.0 – 8.0 mm / 0.28 – 0.32 in																																

FIG.6 - INPUT PROTECTION

Fuse MCB 10 A C curve.

For USA and Canada, use the fuse type closest to the European equivalent type.

Surge protection: it is strongly recommended to provide external surge arresters (SPD) according to local regulations.**FIG.7 - INPUT CONNECTIONS****AC LINE****DC LINE (UL NOT EVALUATED)****FIG.8 - ENVIRONMENT****OPERATING TEMPERATURE**

- 40°C to + 70°C
5 - 95% r.H. non condensing
UL Certified up to 50°C at 100 VAC and 120 VAC
UL Certified up to 60°C at 240 VAC
Overtemperature protection
UL Certified up to 2000 m

DERATING (UL NOT EVALUATED)

- 10 W / °C over 50°C at 100 VAC
- 7.6 W / °C over 50°C at 120 VAC
- 7.2 W / °C over 60°C at 240 VAC

NOTES:

- Data may change without prior notice in order to improve the product.
- Please refer to the latest version of [LDC480 Series Datasheet](#) or [LDC480 Series Installation Instruction](#) on our website: belfuse.com/power-solutions

ACCESSORIES (UL NOT EVALUATED)

- LDX-D50 50 A Active ORing controller
- LDX-U20 20 A High performance DC UPS
- LDX-C120 Battery charger and DC UPS Module
- LDX-L30 Sealed Lead acid Battery pack



Manufacturer
Bel Fuse Inc.
300 Executive Drive, Suite 300
West Orange, NJ 07052
USA

Asia-Pacific
+86 755 2988 5888

Europe, Middle East
+353 61 49 8941

North America
+1 866 513 2839

belfuse.com/power-solutions

© 2023 Bel Fuse Inc. BCM.00407_AH